

- NOTES:**
1. CUSTOMER PIPING MUST BE SUPPORTED NEAR ALL INTERFACE CONNECTIONS TO ELIMINATE STRAIN.
 2. ALL PIPING SUPPORTS ARE NOT SHOWN FOR CLARITY PURPOSES.
 3. ALL POLYMERIC DRAIN LINE PIPING TO THIS LOCATION.
 4. MINIMUM CLEARANCE TO ANY OBSTRUCTION REQUIRED BY THE NATIONAL ELECTRIC CODE.
 5. SHIPPING DIMENSIONS: 176"L x 112"W x 121"H.
 6. ESTIMATED SHIPPING WEIGHT: 13,000 LBS, ESTIMATED OPERATING WEIGHT: 15,000 LBS.
 7. CONDUIT AND SMALL PIPING RUNS TO FOLLOW STRUCTURAL MEMBERS, WHERE POSSIBLE, TO AVOID CREATING TRIP HAZARDS.
 8. TO ACHIEVE THE PROPER BUILDING FOUNDATION DESIGN, AN ENGINEER SHALL BE RETAINED WHO IS FAMILIAR WITH LOCAL BUILDING CODES, SOIL CONDITIONS, AND ANCHORING REQUIREMENTS.
 9. BASE PLATE SETTING PRIOR TO PIPING: GROUTING PROCEDURES AND FINAL ALIGNMENT MUST BE IN ACCORDANCE WITH THE XYLEM A-C FIRE PUMP INSTRUCTION MANUAL.
 10. INSTALL CHECK VALVE WITH HINGE PINS IN THE VERTICAL POSITION.
 11. PRESSURE SENSING LINE DRAINS TO BE PIPED TO THE SKID DRAIN MANIFOLD.




- ITEMS TO SHIP LOOSE:**
- MUFFLER.
 - METERING AND PRESSURE GAUGES.
 - ANY TANK PIPING THAT EXCEEDS THE MAXIMUM SHIPPING DIMENSIONS.

- CUSTOMER INTERFACE CONNECTIONS:**
- A. SUCTION: FLANGED, 8", CLASS 150#.
 - B. DISCHARGE: FLANGED, 6", CLASS 150#.
 - C. MAIN RELIEF VALVE DISCHARGE: FLANGED, 8", CLASS 150#.
 - D. DRAIN: 2" CLASS 150#.
 - E. SINGLE POWER POINT CONNECTION: 460V/3PH/60HZ.

- PAINT SPECIFICATIONS:**
- PAINT PER XYLEM FLOWTRONEX SPEC FPP-002.

BOM			
SYM	DESCRIPTION	P/N	ITEM QTY
1	BATTERY, DRY, DEKA, 908DY	85-006-030-1	2
2	CNTRLR, JOCKEY	---	1
3	ENGINE, DIESEL		1
4	FLOWMETER, GROOVED, GVI 6-1000-G	100-200-606	1
5	FPC, DIESEL	100-300-775	1
6	GAUGE, 3.5, SS, .25, 0-300 DUAL DISP	88-001-279	1
7	GAUGE, 3.5, SS, 0.25, LM, 30-0-30, 100-200KPA	88-001-275	1
8	HEATER, W/ THERMOSTAT	--	1
9	MUFFLER, RESIDENTIAL	---	1
10	PLATE, LIFT, EYE, FOR, 8", WFB EAM	54-007-536	4
11	POWER PAK	80-003-032	1
12	PUMP, GOULDS, eSV, 1-5SV_G	---	1
13	PUMP, 8100, CL150, 8x6x9F, CW	100-210-046	1
14	SHACKLE 5 TON	58-018-500	4
15	SPPC, PANELBOARD	---	1
16	SPRINKLERHEADS	---	2
17	SWITCH, TAMPER, SYSTEM SENSOR OSY2	23-003-050	1
18	TANK, FUEL, 185GAL, DOUBLE WALL, AC	100-200-280	1
19	VALVE, AIR RELEASE, 175PSI, 15A, .5	16-003-005	2
20	VALVE, BFLY, ANVIL, GEAR, W/TAMPER, UL/ULC, 6	20-005-385	2
21	VALVE, BFLY, LUG, NIBCO, LD3510-8, 6	23-002-435	1
22	VALVE, CHECK, NIBCO, KW-900-W, 6	23-002-225	1
23	VALVE, CLA-VAL, 2050B-4KG1, CL150, 4	100-200-456	1
24	VALVE, GATE, OSY, NIBCO, F-607-RW, 8	23-002-530	1
25	WASTE CONE, C.S., 4x8, CL150, CLOSED	100-200-408	1

NOT FOR CONSTRUCTION

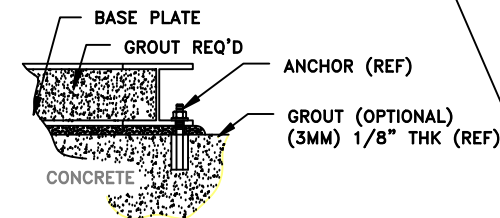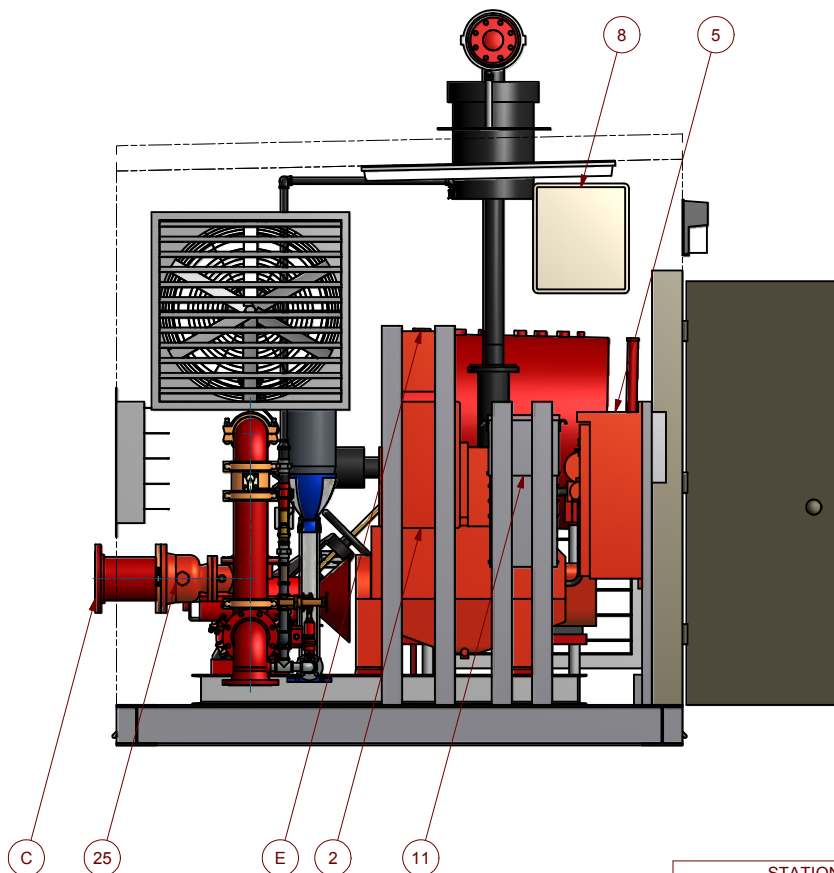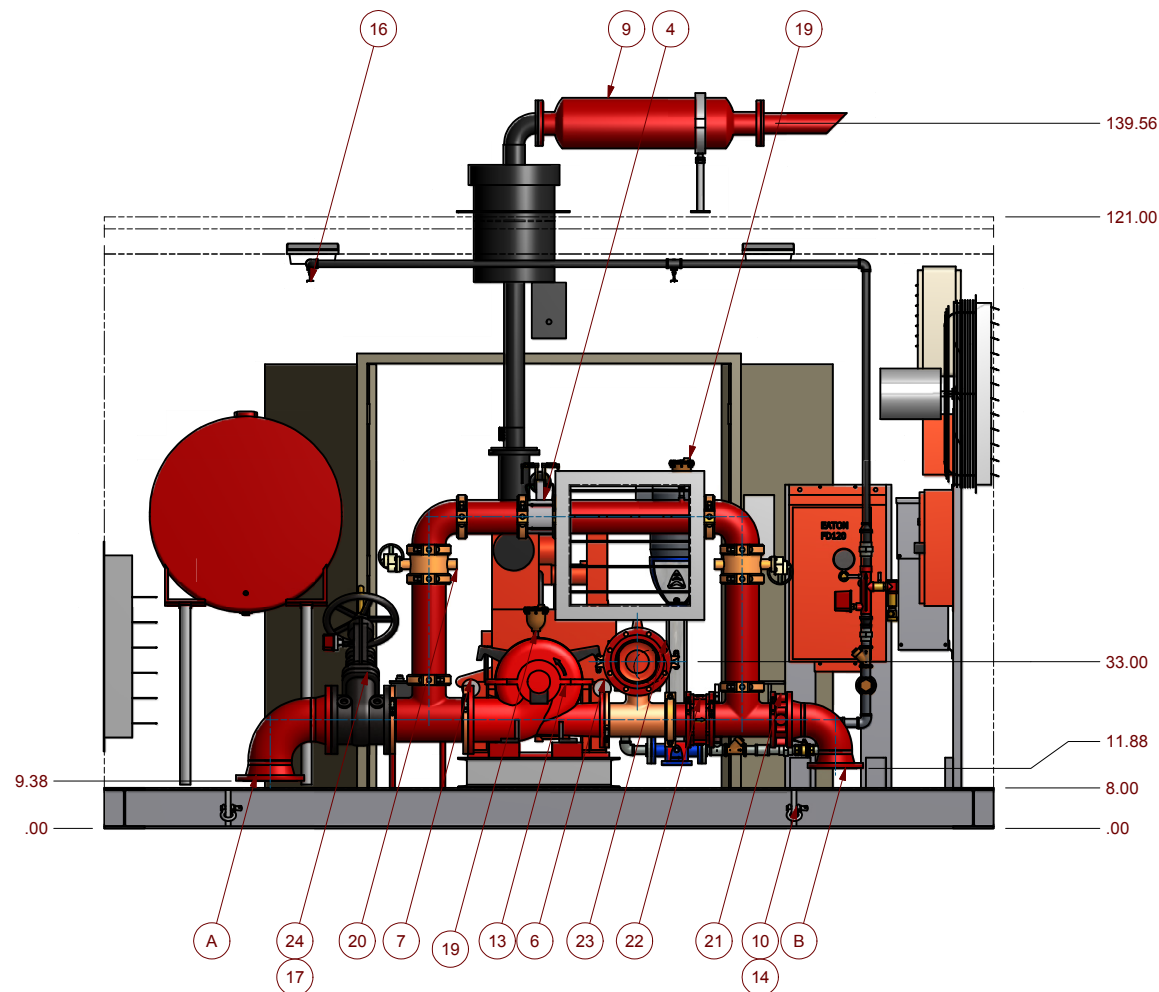


TYPICAL ANCHOR BOLT DETAIL
FOR (25MM) 1.00 DIA, MOUNTING HOLE

(10MM) 3/8" CHAMFER AT
TOP AND BOTTOM
OF PLATE, 30°

LIFT EYE
4 PLCS.
NOT TO SCALE

5 TON
CROSBY #1017516
STYLE G-209-A

STATION PARAMETERS	
GPM: 1000	VOLTAGE: 460
INTAKE PSI: 10	HZ: 60
DISCHARGE PSI: 160	PHASE: 3

 a xylem brand	10661 NEWKIRK STREET DALLAS, TX 75220 800.786.7480		DRN: M. HERNANDEZ	DATE: 10/12/2012
			CHK:	DATE:
			DRAWING #: 1000 GPM	
			DRAWING NAME: DIESEL WITH BUILDING THRU FLOOR	
SIZE B	REV 0	SHEET: 1/1		