


VARIABLE PRIMARY/VARIABLE SECONDARY INSTALLATION SCHEMATIC

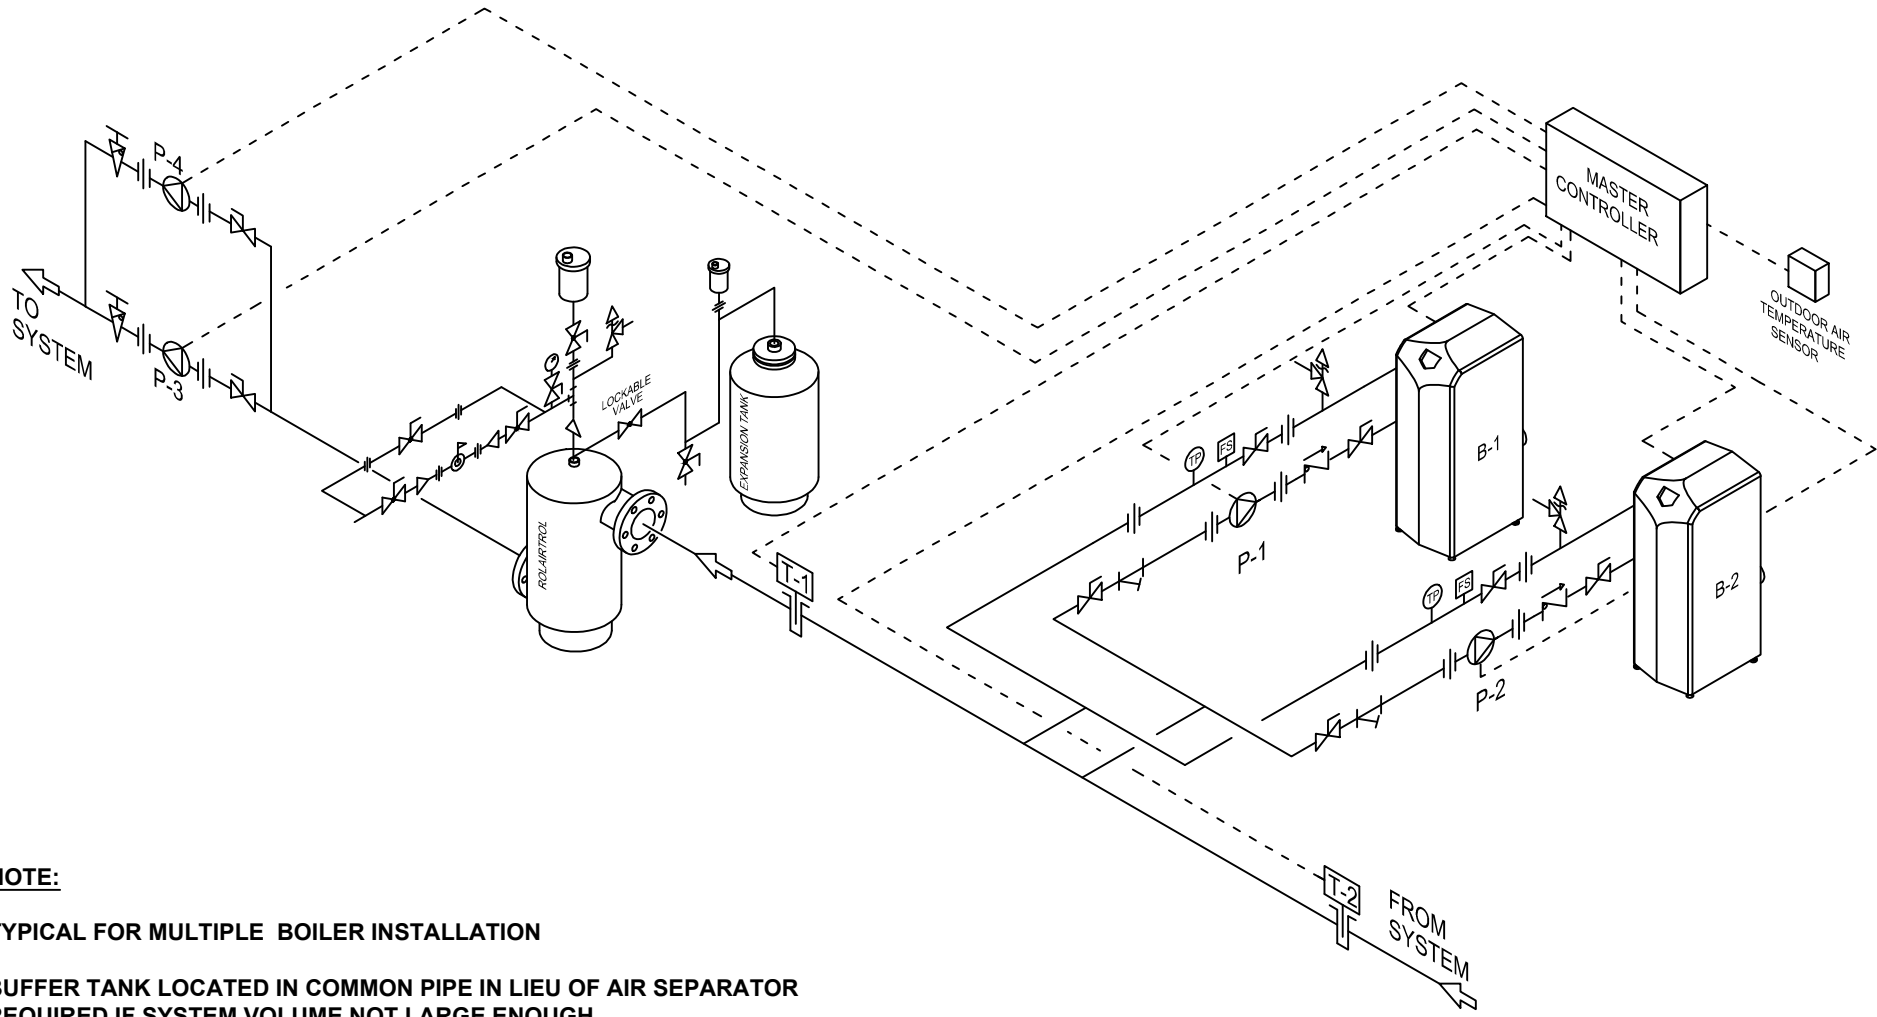

NOTE:

TYPICAL FOR MULTIPLE BOILER INSTALLATION

BUFFER TANK LOCATED IN COMMON PIPE IN LIEU OF AIR SEPARATOR
REQUIRED IF SYSTEM VOLUME NOT LARGE ENOUGH

THIS DRAWING AND THE INFORMATION DEPICTED THEREIN IS THE PROPERTY OF JAMES M. PLEASANTS CO., INC. COPIES SHALL NOT BE REPRODUCED OR COPIED, OR USED AS THE BASIS FOR THE MANUFACTURE OR SALE OF PRODUCTS WITHOUT PRIOR PERMISSION OF JAMES M. PLEASANTS CO., INC.

PROJECT NAME:

DATE:

CHK.D BY:

DATE:

DWG. BY:

